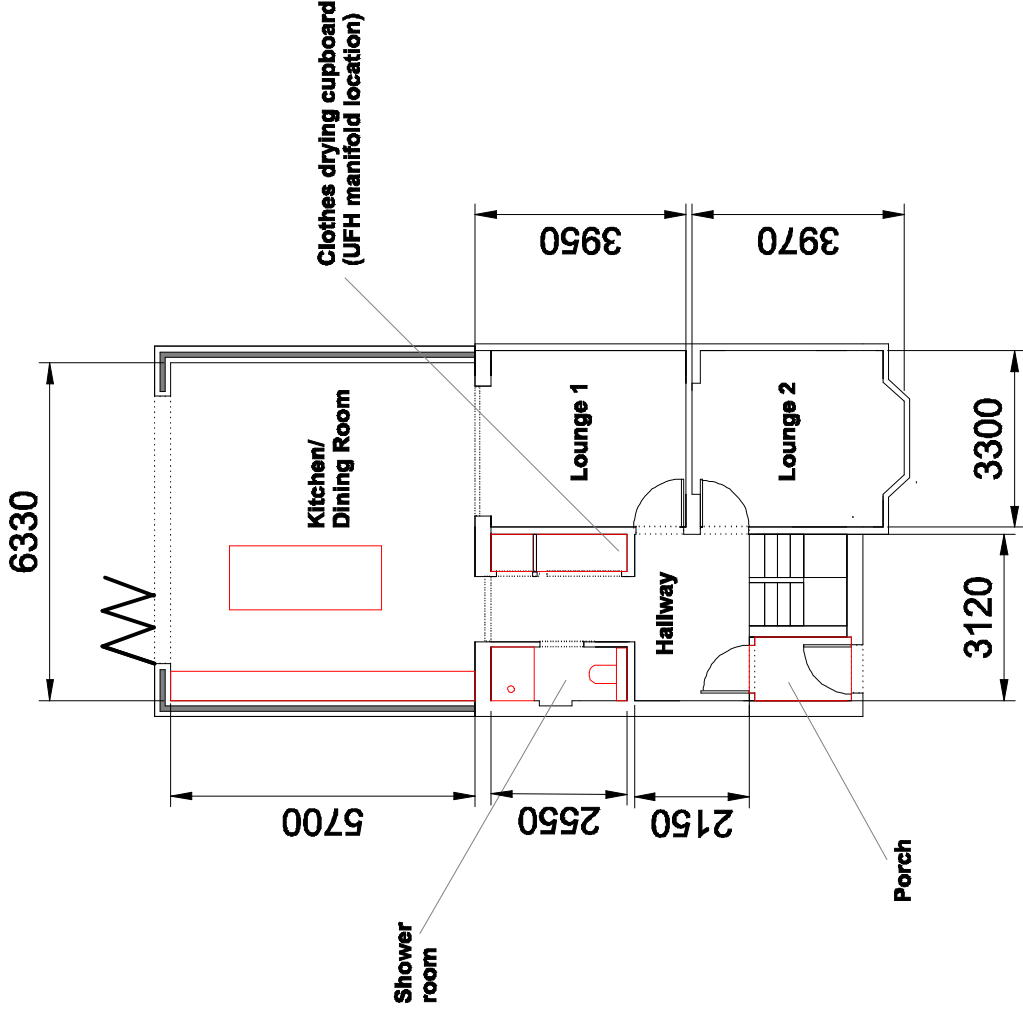


Notes:-

- Manifold located in Clothes drying cupboard
- Areas marked in red do not require UFH
- Clip rail system required (due to insulation thickness)
- LVT Flooring (27 degrees max floor temperature)
- 4 individually controlled zones required :-
 - Zone 1 = Kitchen/Dining room
 - Zone 2 = Lounge 1
 - Zone 3 = Lounge 2
 - Zone 4 = Hallyway and Shower room
- The shower room will have a heated towel radiator for additional heat

SCALE :1:100

DATE: JULY 2023
DIMENSIONS: MM
PAPER SIZE: A3

TITLE:
98 LIMPSFIELD ROAD
WARLINGHAM
CR6 9RA

DESCRIPTION:
GROUND FLOOR PLAN

DRAWING NUMBER:
UFH - 01